


4.5 Piping Diagrams (niski part 2)




The drawing may differ from actual conditions due to limitations of the software. Please confirm before installation according to the installation manual.

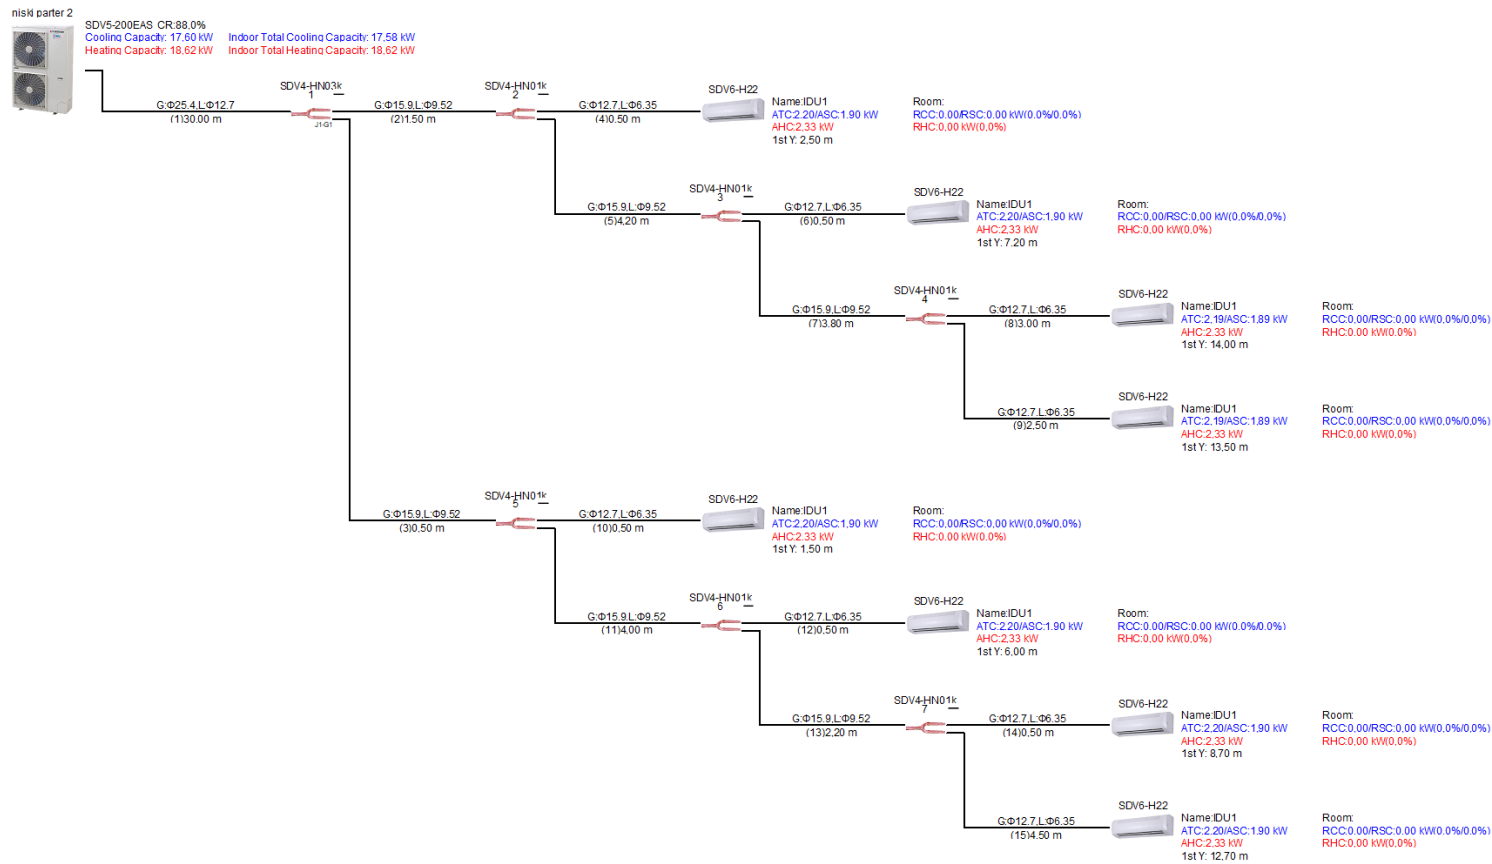

SDV5-200E4S CR88.0%
Cooling Capacity: 17.60 kW Indoor Total Cooling Capacity: 17.58 kW
Heating Capacity: 16.92 kW Indoor Total Heating Capacity: 16.92 kW

- POE(IDU and ODU communication wire,
0.75mm2 three-core shielded cable should be used)
- D1D2(Group control communication wire,
0.75mm2 two-core shielded cable should be used)
- ABCD(E)Infrared communication wire,
0.5mm2 four-core shielded cable should be used)
- X1X2 (Power line communication wire,
0.75mm2 two-core shielded cable should be used)
- D1D2+X1X2(Group control communication and power wire,
0.75mm2 two-core shielded cable
+0.75mm2 two-core shielded cable should be used)
- XVE (ODU and ODU communication wire,
0.75mm2 three-core shielded cable should be used)
- Power wire

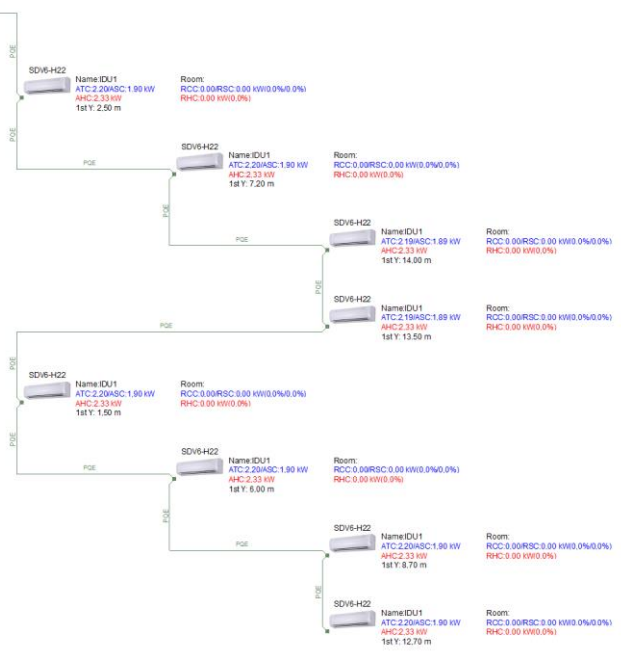

The drawing may differ from actual conditions due to limitations of the software. Please confirm before installation according to the installation manual.